


BEDDING "A"
CRUSHED ROCK
GRADATION

SIEVE SIZE	% PASSING SIEVES
1"	100
3/4"	90-100
1/2"	30-60
3/8"	0-20
NO. 4	0-5

ASTM C131 TEST
 GRADING-B

'W'=6" FOR 60" DIAMETER OR LESS
 10" FOR 63" TO 108" DIAMETER
 12" FOR 108" DIAMETER OR LARGER

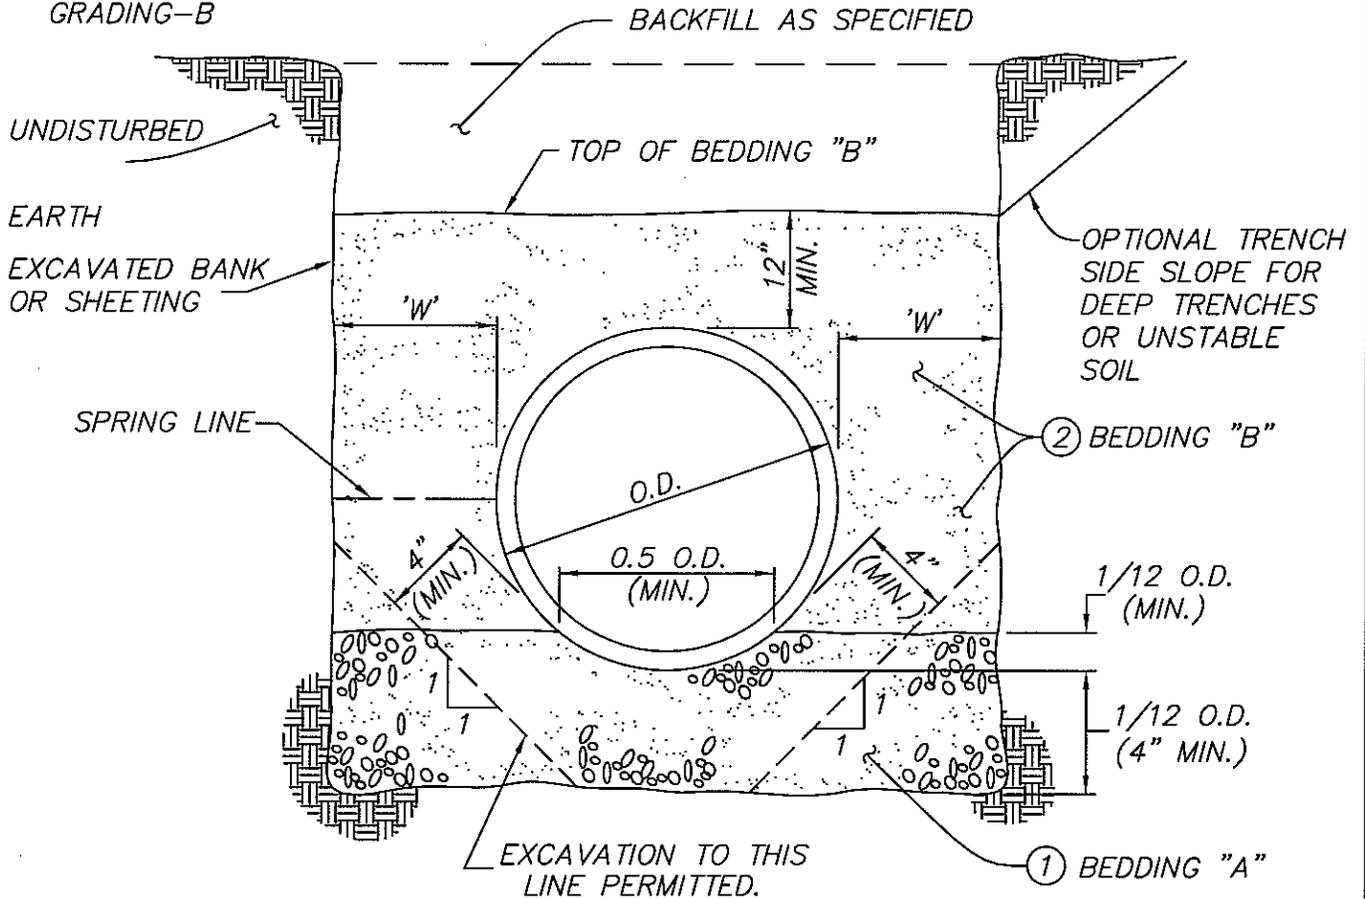

NOTES:

- ① BEDDING "A" SHALL BE SAND (SAND EQUIVALENT NOT LESS THAN 30) OR CRUSHED ROCK PER GRADATION TABLE HEREON.
- ② BEDDING "B" SHALL BE COMPOSED OF SAND OR OTHER GRANULAR MATERIAL (SAND EQUIVALENT OF NOT LESS THAN 30) AND SHALL BE COMPACTED TO A RELATIVE COMPACTION OF NOT LESS THAN 90% WITHIN 3' FROM FINISH SURFACE, AND 85% COMPACTION BELOW 3'.

APPROVED:

R. E. Richblatt

CITY ENGINEER

REVISION DATE: March 21, 1994

CITY OF HUNTINGTON BEACH

DEPARTMENT OF PUBLIC WORKS



REINFORCED CONCRETE
 PIPE BEDDING DETAIL

STANDARD PLAN
 308
 1 of 1