

TRENCH WIDTH & BEDDING "B" REQUIREMENTS:

OPTION 1

SAND COMPACTED TO A RELATIVE COMPACTION OF NOT LESS THAN 90%.

PIPE DIAMETER	TRENCH WIDTH
18" TO 36"	O.D.+36"
39" TO 48"	O.D.+48"

OPTION 2

3/4" MAX. CRUSHED ROCK COMPACTED TO A RELATIVE COMPACTION OF NOT LESS THAN 90%.


PIPE DIAMETER	TRENCH WIDTH
18" TO 36"	O.D.+24"
39" TO 48"	O.D.+36"

OPTION 3

SLURRY OR CLSM, 1 SACK CEMENT

PIPE DIAMETER	TRENCH WIDTH
18" TO 48"	O.D.+10"

GASKET PER
ASTM F-477 IN
VALLEY OF 1ST
CORRUGATION

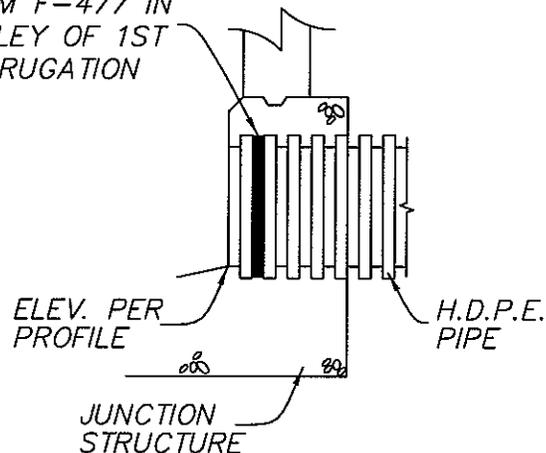

MANHOLE CONNECTION DETAILS

APPROVED:

[Signature]
CITY ENGINEER

CITY OF HUNTINGTON BEACH

DEPARTMENT OF PUBLIC WORKS



REVISION DATE: MAY 2008

H.D.P.E. PIPE BEDDING DETAILS

STANDARD PLAN
315
2 of 2