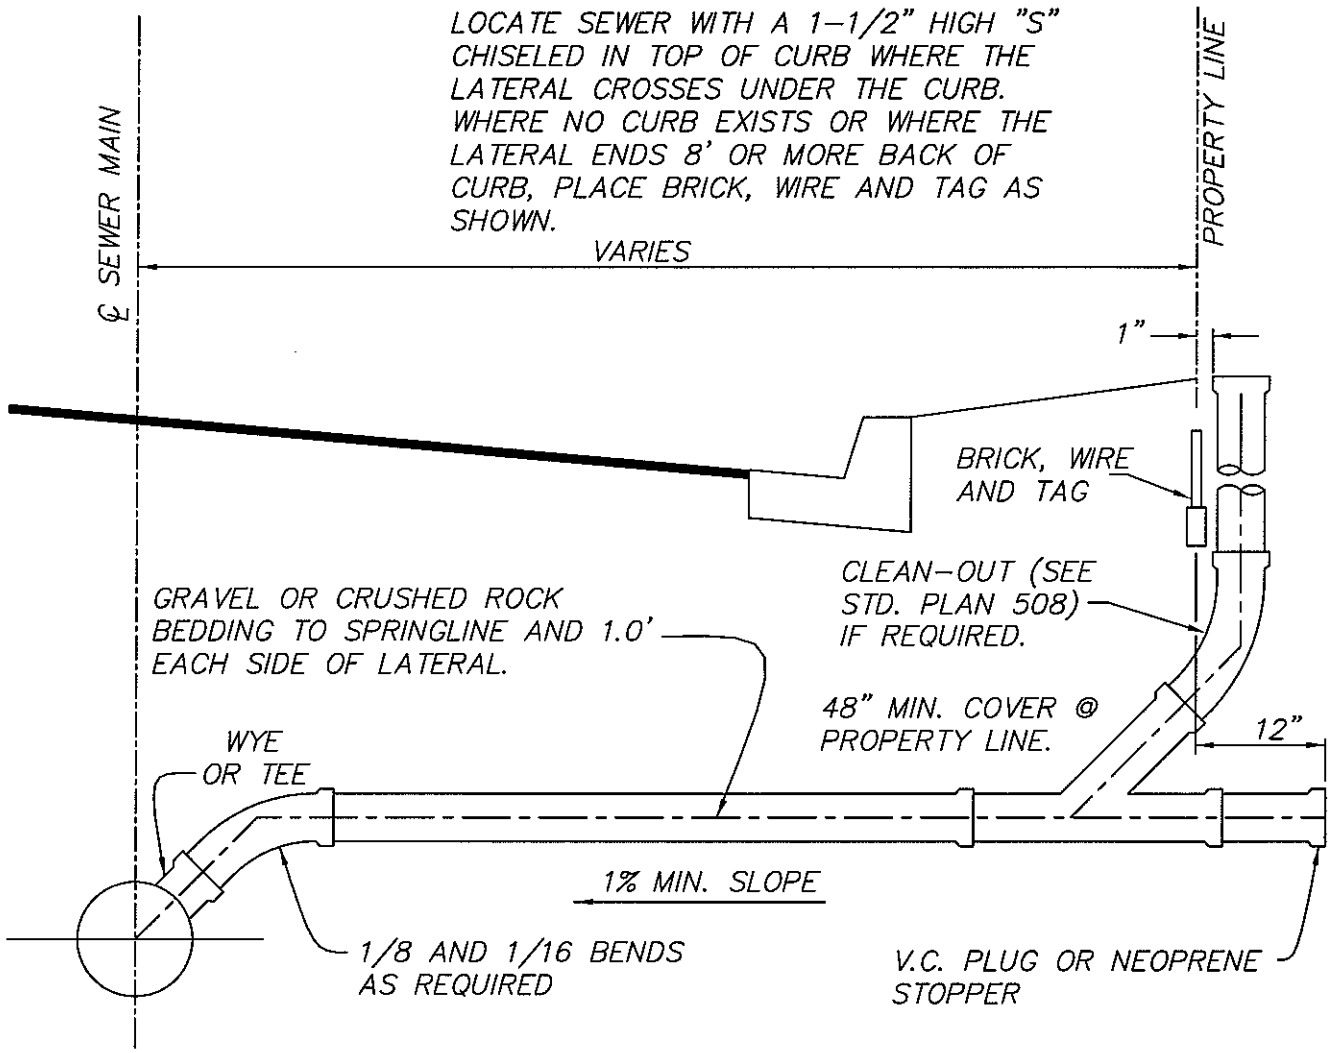


GENERAL NOTES:

1. WHERE A WYE OR TEE IS INSTALLED WITHOUT HOUSE LATERAL, A V.C. PLUG OR NEOPRENE STOPPER SHALL BE INSTALLED.
2. LATERAL SIZE TO BE DETERMINED ON THE BASIS OF THE TOTAL NUMBER OF FIXTURE UNITS DRAINED. IN NO CASE SHALL THE LATERAL BE LESS THAN 4" FOR SINGLE FAMILY RESIDENTIAL, 6" FOR COMMERCIAL, INDUSTRIAL, OR MULTI-FAMILY RESIDENTIAL.
3. THE LATERAL SHALL BE BEDDED THE SAME AS THE MAINLINE SEWER. SEE STD. PLANS 502 AND 503.
4. AS-BUILT SEWER LATERAL LOCATIONS SHALL BE FURNISHED TO THE PUBLIC WORKS INSPECTOR ON FORMS PROVIDED PRIOR TO FINAL APPROVAL OF WORK, AND SHALL BE SHOWN ON PLANS.
5. AT ALL WATER MAIN CROSSINGS REFER TO STD. PLAN 501 AND H.B. MUNICIPAL WATER DIVISION SPECIAL CONDITIONS.
6. FOR CUT IN WYE OR SADDLE CONNECTION SEE STD. PLANS 510 AND 511 RESPECTIVELY.
7. WHEN CONNECTING TO AN EXISTING MAIN WHICH HAS BEEN LINED, SEE STD. PLAN 516.

APPROVED:

CITY ENGINEER

REVISION DATE: MAY 2008

CITY OF HUNTINGTON BEACH

DEPARTMENT OF PUBLIC WORKS

TYPICAL SEWER LATERAL

STANDARD PLAN 507

1 of 1