


RUBBER SLEEVE FOR INSERTA TEE. \* HUB ADAPTOR NOT SHOWN FOR CLARITY.

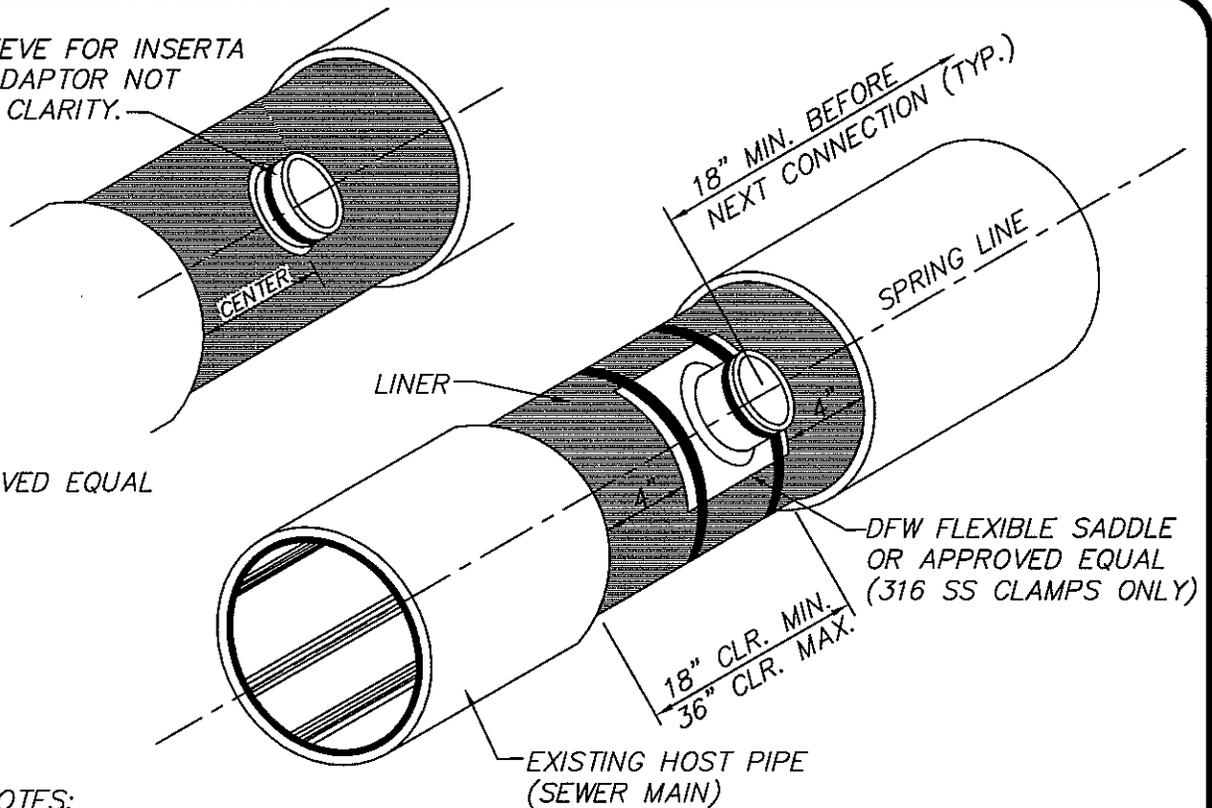

\* OR APPROVED EQUAL

GENERAL NOTES:

1. TO BE USED ONLY WHEN A LATERAL (4"-6") IS TO BE CONNECTED TO AN EXISTING SEWER MAIN (8"-15") THAT HAS BEEN LINED PER SECTION 500 OF THE GREEN BOOK.
2. FOR CONTINUATION OF LATERAL SEE STD. PLAN 507.
3. LATERALS SHALL BE SPACED APART BY A MIN. OF 18" ON CENTER UNLESS OTHERWISE APPROVED BY THE DIRECTOR OF PUBLIC WORKS.
4. THE HOLE FOR THE LINER TAPPING SLEEVE FOR THE SEWER LATERAL SHALL BE MADE BY CORE DRILLING. THE HOLE SHALL BE CLEANLY MACHINED AND IF NECESSARY WORKED BY HAND WITH A RASP OR SANDED TO ACCOMPLISH A TRUE AND NEAT OPENING FOR THE SADDLE. (REMOVE AND SAVE ALL CORINGS AND DELIVER TO PUBLIC WORKS INSPECTOR.)
5. UPON APPROVAL OF CONNECTION BY THE PUBLIC WORKS INSPECTOR, THE CONTRACTOR SHALL CONCRETE ENCASE THE CONNECTION PER THE GREENBOOK, 6" THICK MIN. AND OVERLAPPING THE HOST PIPE 6" MIN.
6. THE CONTRACTOR SHALL KEEP ALL CHIPS, DIRT, MORTAR, AND CONCRETE OUT OF THE SEWER SADDLED, AND SHALL PERFORM A CLEANING AND BALLING OF THE REACH SADDLED IF DIRECTED TO DO SO BY THE PUBLIC WORKS INSPECTOR.
7. THE CONTRACTOR SHALL REPAIR OR REPLACE ANY DAMAGED PIPE AS DIRECTED BY THE PUBLIC WORKS INSPECTOR.
8. CONNECTION SHALL BE BETWEEN SOFFIT AND SPRING LINE OF MAIN UNLESS OTHERWISE APPROVED BY THE DIRECTOR OF PUBLIC WORKS.
9. CONTRACTOR SHALL EXPOSE LINER BY USING A PIPE CUTTER TO SNAP EXISTING VCP TO A CLEAN STRAIGHT EDGE.
10. THE PUBLIC WORKS INSPECTOR SHALL APPROVE THE PROPOSED TAPPING SLEEVE PRIOR TO INSTALLATION.

APPROVED:

*[Signature]*

CITY ENGINEER

CITY OF HUNTINGTON BEACH

DEPARTMENT OF PUBLIC WORKS



TAPPING SLEEVE  
FOR  
"LINED" SEWER MAIN

STANDARD PLAN

516

1 of 1

REVISION DATE: MAY 2008